E2 STATUS REPORTING AND CONTROL SYSTEM MANUAL ALARM CENTRAL OPERATING PROCEDURES

	CONTENTS PA	AGE
1.	GENERAL	1
2.	OPERATION	4
	A. Alarm Polling	4
	CHART 1—ALARM INDICATIONS	7
	CHART 2—STATION FAILURE	8
	B. Status Display Reporting	8
	CHART 3—STATUS DISPLAY REPORTING .	9
	C. Remote Switching	9
	CHART 4—REMOTE SWITCHING	10
3.	TROUBLE ISOLATION AND SECTIONALIZATION	10

1. GENERAL

- 1.01 This section describes the operating procedures for the manual alarm central used with an E2 Status Reporting and Control System. The manual alarm central, referred to simply as central, is used for reporting alarms and status indications and for operating remote switches.
- 1.02 This section is reissued to revise Part 3 on trouble isolation and sectionalization, to incorporate the new bay configuration, and to make minor text changes. Since this reissue constitutes a general revision, marginal arrows ordinarily used to indicate changes have been omitted.

- two bay configurations, depending on the number of data facilities used. The two configurations are shown in Fig. 1A and 1B. Note that the equipment in the J92617 bay in Fig. 1B is expanded to accommodate two data facilities. However, when the data facility configurations are used, the remote call-up feature cannot be used.
- 1.04 The alarm display panel (Fig. 2) indicates the results of the automatic alarm polling mode. A panel can contain two sets of eight vertical columns of electromagnetic indicators, with each column representing a remote station. There are seven indicators per vertical column. Six of the indicators represent alarms from that remote station and one represents the remote station failure. An additional panel may be furnished for a central serving more than 16 remote stations. Figure 2 shows only one such panel.
- 1.05 When an alarm is indicated, the alarm polling mode may be interrupted manually and the status display report mode initiated. This pinpoints the alarm to a specific status indication.
- 1.06 The status display and remote switch control panel (Fig. 3) is used for both the status display reporting operation and the remote switching operation. This panel will be referred to as the control panel in the remainder of this section.
- 1.07 For initiating a status display report, the control panel is used to manually select a remote station (also referred to in this section simply as remote) and to request a particular status display report from that remote. The report is displayed on the status display for analysis. The

NOTICE

Not for use or disclosure outside the Bell System except under written agreement

		<u> </u>
↑		
	FILTER AND FUSE	FILTER AND FUSE
	DATA MODULE	DATA MODULE
	JACK STRIP LOGIC	DATA MODULE
	LOGIC	JACK STRIP
	ALARM DISPLAY PANEL	LOGIC
		• LOGIC
1 1		LOGIC
	STATUS AND CONTROL PANEL	ALARM DISPLAY PAMEL
7'-0"	WRITING SHELF	ALARM DISPLAY PANEL
		STATUS AND CONTROL PANEL
	RCU	MRITING SHELF
	Noo	
	SPARE CIRCUIT	
1 1	PACKS	
		SPARE CIRCUIT PACKS
		-
	Α.	n
		8.

Fig. 1—Typical Manual Alarm Central (J92617)

display is an 8-by-8 matrix of electromagnetic indicators. A parity error in transmission or failure to reply to the manual alarm central causes the ERROR lamp on the control panel to light.

1.08 When a remote switch operation is to be performed, the control panel is used to manually select a remote station in order to initiate the remote switch command. The remote performs a momentary contact closure for the switch selected and sends a reply informing the central that the remote switch command was received. This reply does not verify that the momentary closure was made. The only way to verify the remote switch

operation is to perform a status display report for the switch. This verification is valid only if the switch is also wired as a status. If a parity error occurs in transmission or if the manual alarm central does not receive verification that the remote station received the command correctly, the ERROR lamp lights.

1.09 Manual alarm central transmissions are received by all remotes on the same data network. Each remote has a discrete address and responds only to transmissions containing the proper address. System operation is controlled by commands transmitted from the manual alarm central.

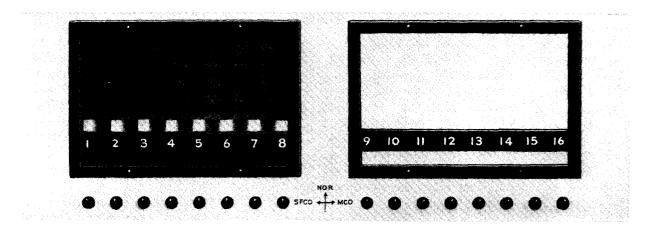


Fig. 2—Typical Alarm Display Panel

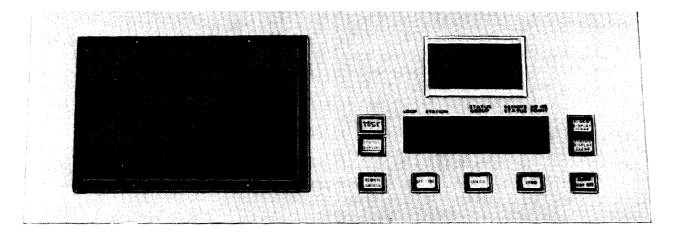


Fig. 3—Typical Status Display and Remote Switch Control Panel

2. OPERATION

A. Alarm Polling

- 2.01 Alarm polling is an automatic mode of operation where the manual alarm central transmits a word to a remote, requesting alarm information. After that remote responds, the manual alarm central automatically polls the next remote. This sequence continues until all remotes have been polled. The cycle is then started again automatically. Thus, alarm polling is continuous unless it is interrupted by one of the other modes.
- 2.02 There are two types of alarm conditions reported to the manual alarm central and displayed on the alarm display panel: monitored equipment alarms and E2 station failure alarms. The monitored equipment alarms are conditioned at the remote to respond to NEW alarm and an ANY alarm indication. The NEW alarm indication is retired when the central reports the status display containing the status point which is in the alarm state. The ANY alarm indication remains until the alarm in the monitored equipment is retired. The station failure alarm indicates that a remote station has failed to respond to a request from the central. Chart 4 describes the operation of the station failure alarms. (Also, see 2.04.)
- 2.03 A 16-station alarm display panel, where the 16 stations are on the same data network, consists of a panel containing a maximum of 16 columns of indicators. Each column is permanently associated with a particular remote and contains six indicators representing alarm or status indications and one indicator representing remote station failure.
- 2.04 Provided on the alarm display panel is an MCO/SFCO key for each remote station. The SFCO position inhibits activation of the office audible alarm in the event of a station failure. This position does not inhibit NEW alarms from displaying or activating audible alarms. The MCO position inhibits activation of the office audible alarm upon receipt of a NEW alarm from that station. The MCO position does not inhibit visual indications from being presented on the alarm

display panel and does not inhibit audible alarms caused by station failure.

Caution: The MCO position should be used only when a remote station is being manned by qualified personnel who assume responsibility for alarms when they occur in the station.

- A number of two-state status indications at a remote may be combined to form alarm categories. The indicators on the alarm display panel are paired and associated with an alarm category (Fig. 4). One indicator is called an ANY alarm and indicates whether one or more of the categories are in the alarm state. The other indicators are assigned as **NEW** alarms and indicate when any one of the status indications in that alarm category changes from the no-alarm state to the alarm state. The assignment of the six indicators in a column is optional. For example, instead of pairing indicators, it is possible to have five of the indicators represent **NEW** alarms and one indicator to represent an ANY alarm. For the latter case, the ANY indicator would be set as long as there was a status indication in the alarm state in any of the five alarm categories.
- 2.06 E2 systems wired in accordance with the new standard assignment philosophy may have one of two possible alarm indicator arrangements; one for E2 systems in which all remotes in the system have four or fewer displays (Fig. 5), and one for E2 systems in which any remote contains more than four displays (Fig. 6). The standard assignment philosophy relates information displayed in the alarm poll word to specific status displays. When a system incorporates remotes which have four or more displays, a display called an alarm index display is used. The bit assignments in this index display correspond to the number of the display in which the alarm occurred via the conversion shown in Table A.
- 2.07 The charts which follow describe the procedures used when an alarm or a station failure is indicated.

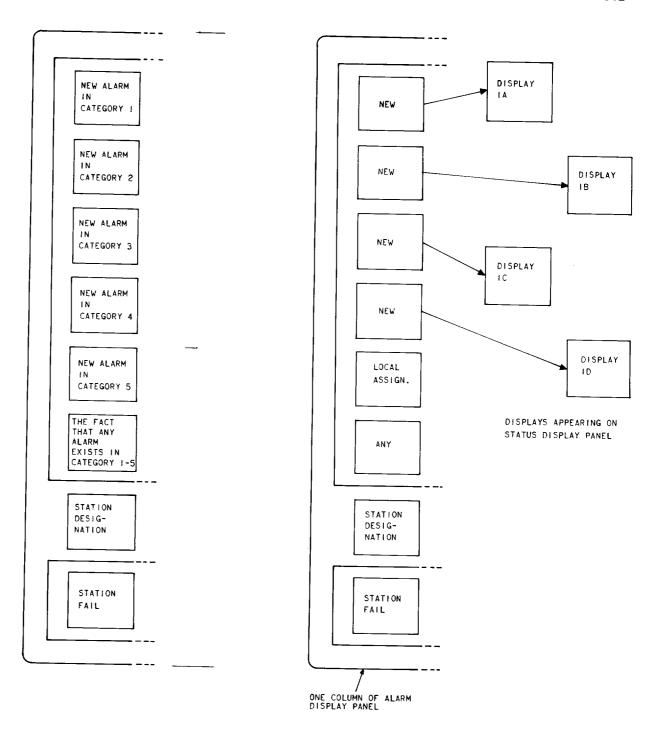


Fig. 4—Alarm Display—Typical Indicator Assignment

Fig. 5—Alarm Display for E2 Systems in Which All Stations Have Four Status Displays (New Assignment Philosophy)

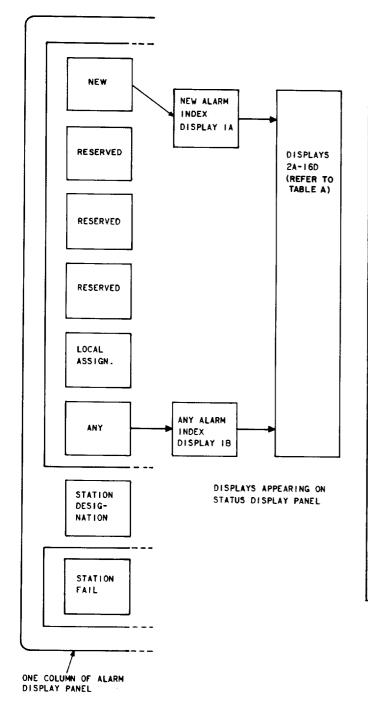


Fig. 6—Alarm Display for Stations Having More Than Four Status Displays (New Assignment Philosophy)

TABLE A

CONVERSION OF ALARM INDEX DISPLAY NUMBERS

CONTENSION OF ALAMIN INDEX DISPLAT NOWIBERS				
INDICATOR NUMBER	DISPLAY ADDRESS	INDICATOR NUMBER	DISPLAY ADDRESS	
5	2A	35	9C	
6	2B	36	9D	
7	2C	37	10A	
8	2 D	38	10B	
9	3A	39	10C	
10	3B	40	10D	
11	3C	41	11A	
12	3D	42	11B	
13	4A	43	11C	
14	4B	44	11D	
15	4C	45	12A	
16	4D	46	12B	
17	5A	47	12C	
18	5B	48	12D	
19	5C	49	13A	
20	5D	50	13B	
21	6A	51	13C	
22	6B	52	13D	
23	6C	53	14A	
24	6D	54	14B	
25	7A	55	14C	
26	7B	56	14D	
27	7C	57	15A	
28	7D	58	15B	
29	8A	59	15C	
30	8B	60	15D	
31	8C	61	16A	
32	8D	62	16B	
33	9A	63	16C	
34	9B	64	16D	

Example: If indicator 12 is lighted in the new Alarm Index Display 1A, there is a new alarm somewhere in display

ALARM INDICATIONS

STEP **PROCEDURE** When an alarm indication is reported to the manual alarm central, the NEW alarm indicator for that alarm category and the ANY alarm indicator are set (show a yellow flag). The major or minor alarm sounds. 1 Depress the ALARM CUTOFF pushbutton on the control panel. The audible alarm is silenced. The ALARM CUTOFF lamp is lighted. 2 Initiate a status display report for the alarm category in which the NEW alarm is indicated (see 2.08 through 2.10 and Chart 3). The remote station number is designated on the panel just above the station failure indicator. 3 Depress the ALARM CUTOFF pushbutton on the control panel. The ALARM CUTOFF pushbutton is released. The ALARM CUTOFF lamp is extinguished. Note 1: As the remote is polled again, all the indicators for it are automatically updated. That is, the ANY indicator remains set as long as the trouble exists, but the NEW indicator is cleared. However, if a different alarm situation is detected on this poll, the NEW indicator is set again and the major or minor alarm sounds. If a display report is not initiated between the alarm poll which detected an alarm situation and the next alarm poll for that station, the NEW indicator remains set until the proper display is scanned. Note 2: All the indicators on the alarm display panel may be reset by depressing the ALARM DISPLAY CLEAR pushbutton. On the next alarm poll cycle, the remote station having alarms again sets the NEW and ANY indicators. The function of the ALARM DISPLAY CLEAR pushbutton is to clear the panel indicators at the manual alarm central. However, it does not clear the alarm indication at the remote station. A status display report must be initiated for the affected status display to clear the NEW indication at

the remote station.

STATION FAILURE

STEP

PROCEDURE

When a remote station fails to respond to an alarm polling request with a valid reply within an established time interval, the SF (station failure) indicator is set on the alarm display panel and the major alarm sounds.

- Depress the ALARM CUTOFF pushbutton on the control panel. The audible alarm is silenced. The ALARM CUTOFF lamp is lighted.
- 2 Depress the ALARM DISPLAY CLEAR pushbutton on the control panel. The SF indicator clears.
- 3 Depress the ALARM CUTOFF pushbutton on the control panel. The ALARM CUTOFF lamp is extinguished.
- Turn the MCO/SFCO key on the alarm display panel to the SFCO position if the remote station continues to fail, to keep the audible alarm from sounding. The SF indicator is set. After the trouble has been cleared, return the MCO/SFCO key to the normal position and press the ALARM DISPLAY CLEAR pushbutton to clear the SF indicator.

B. Status Display Reporting

- 2.08 In the status display reporting mode, the operator can, through the use of the control panel, select any group of 64 status points at a remote station for simultaneous display on the 8-by-8 status display panel. The operator may request a particular display report as a result of an alarm indication received during an alarm poll or simply to watch one or more points in a display.
- 2.09 Each status display has a discrete address which contains a group number and a letter.

A through D. Thumbwheel switches are provided on the control panel to select the proper address.

2.10 Selection of the proper status display from an alarm report depends upon the arrangement of the particular system. In E2 systems having an alarm report arrangement as in Fig. 4, the operator must consult the station records. In E2 systems with an arrangement as shown in Fig. 5, each alarm indicator has an associated detailed status display. In stations having many displays arranged as in Fig. 6, each alarm indicator has an associated index display which in turn points to a detailed status display.

STATUS DISPLAY REPORTING

STEP	PROCEDURE	
1	Select the data network and the remote station on the LOOP STATION thumbwheel switches.	
2	Select the desired status display on the STATUS GROUP thumbwheel switches.	
3	Depress the STATUS REPORT pushbutton. The STATUS REPORT lamp is lighted.	
4	Depress the SEND pushbutton. Status indications for the selected display are then displayed on the panel for analysis. The SEND pushbutton is lighted during the report operation.	
	Note 2: If the ERROR lamp is lighted when the SEND lamp extinguishes, the displayed information is incorrect. Reinitiate the report by depressing the SEND pushbutton again. This should correct the display.	
5	Depress the STATUS DISPLAY CLEAR pushbutton. All display indicators are reset.	

C. Remote Switching

2.11 Control switches are provided on the control panel for initiating the momentary closure

of specific relay contacts at remote stations. The procedures for carrying out this operation are described in the following steps to be performed at the central.

REMOTE SWITCHING

STEP	PROCEDURE		
1	Select the data network and the remote station on the LOOP STATION thumbwheel selectors.		
2	Select the remote switch address on the three thumbwheel switches designated REMOTE SW or STATUS POINT.		
	Caution: Check that the proper switch address is selected.		
3	Depress and hold the REMOTE SWITCH pushbutton.		
4	With the REMOTE SWITCH pushbutton held operated, depress the SEND pushbutton. Release both pushbuttons. The REMOTE SWITCH and SEND lamps light and remain lighted during the operate-remote-switch sequence.		
5	If the ERROR lamp is lighted when the REMOTE SWITCH and SEND lamps are extinguished, the information was not received correctly. Repeat Step 4.		
6	If the remote switch is wired as a status, initiate a status display report to determine that the proper switch has operated.		

3. TROUBLE ISOLATION AND SECTIONALIZATION

3.01 If a trouble condition occurs, refer to the Initial Trouble Diagnoses Section 201-644-501.