


NOTES:  
FOR UNITS SMALLER THAN 10 TONS PROVIDE  
ONLY CAPPED BRASS WELLS FOR THERMOMETER  
AND TAPS FOR PRESSURE GAUGE

1. PROVIDE CAPPED THERMOMETER WELLS ON ALL  
INSTALLATIONS.

<b>WATER CHILLER CONNECTIONS</b>	Bell System Standard Detail A.T.& T. Co. 195 Broadway, N.Y.	
	SCALE-NONE	SD - 37
	ISSUED - 1970	

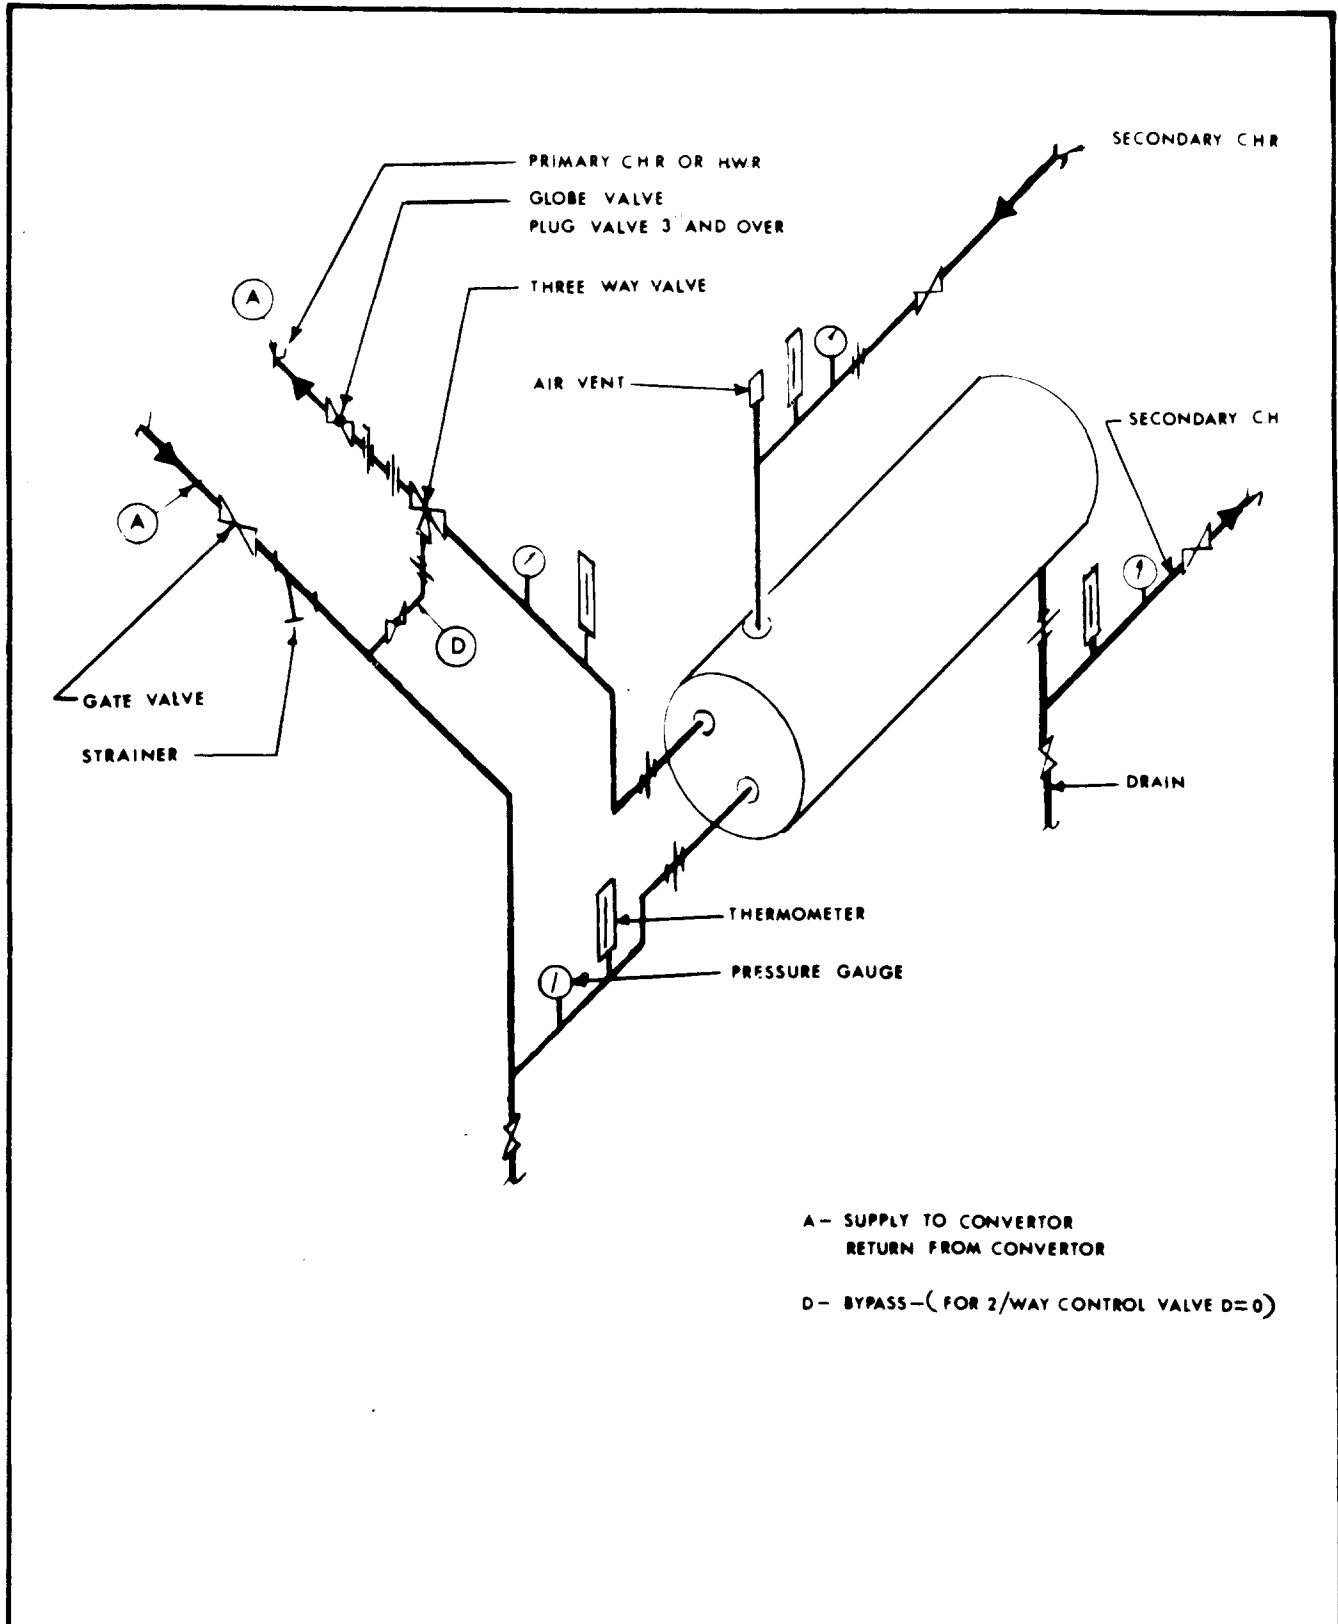

<p><b>WATER TO WATER HEAT EXCHANGER</b></p>	<p>Bell System Standard Detail A.T. &amp; T. Co. 195 Broadway, N.Y.</p>	
	<p>SCALE-NONE</p>	<p>SD- 38</p>
	<p>ISSUED - 1970</p>	